

H

SMITH® JAY R. SMITH MFG. CO.®
 MEMBER OF MORRIS GROUP INTERNATIONAL
 POST OFFICE BOX 3237
 MONTGOMERY, ALABAMA 36109-0237 (USA)
 TEL: 334-277-8520 FAX: 888-377-7818 www.jrsmith.com





LOCATION

NARROW WALL WARM CLIMATE HYDRANT

HYDRANT BOX FOR 6"(150) DIAMETER CORED HOLE IN CONCRETE WALL

FUNCTION: For installation in interior or exterior wall of building where a concealed hose connection is desired and there is no danger of freezing. Hydrant features an integral type vacuum breaker. The stainless steel recessed box conceals the nozzle and operating mechanism. The locking cover prevents unauthorized use.

Installer is responsible for providing a 100% watertight positive seal at the hydrant to box interface and hydrant to wall interface. Seal all interior joints, seams, gasket seams/closures including around the hydrant box flange with an appropriate sealant recommended by a sealant manufacturer. NOTE: Jay R. Smith does not warrant the performance or life expectancy of the sealant material.

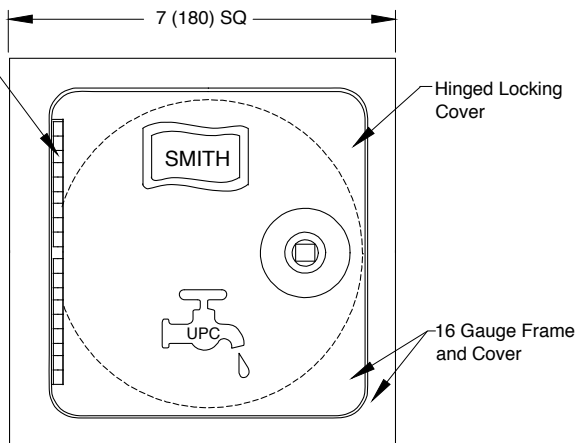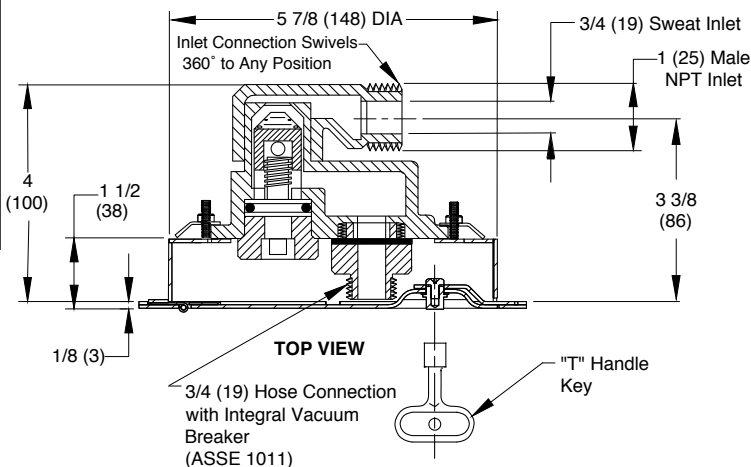

NOTES:

1. Recommended wall opening 6"(150) dia.
2. All Jay R. Smith hydrants are manufactured with "NO LEAD" brazing rings and USDA approved lubricants.
3. The AB1953, California Lead Law, and NSF/ANSI Standard 61-2008 - Drinking Water System Components are not applicable to Jay R. Smith hydrants as they do not convey/dispense water for human consumption through drinking or cooking.
4. Dimensions shown in parentheses are in millimeters.
5. Lead Free Construcion/Materials.

REGULARLY FURNISHED:
 All Bronze Warm Climate Hydrant with Chrome Plated Face, Hose Connection having an Integral ASSE 1011 Vacuum Breaker, 360° Swivel Inlet Connection. Stainless Steel Box for 6"(150) Cored Hole and "T" Handle Key.

VARIATIONS:
 [] Cylinder Lock -CL
 [] "Water" on Cover -W

A small amount of water seepage may occur from the vacuum breaker and operating screw upon initial opening and closing of the hydrant. This is normal operation.



Certified by Truesdail Laboratories. Meets all Federal and state Safe Drinking Water Acts and requirements.

NSF/ANSI 372

DRAWING NUMBER
5518-R

SIZE
A

SCALE:
NONE

DATE:
6-21-11

APPROVED BY:
CL

CHECKED BY:
CL

DRAWN BY:
TBW

FIGURE NUMBER
5518-R

DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

H G F E	11-15-19 4-5-18 2-6-17 7-20-16	Revised Note Added Note Added Truesdail Note Added Note	MW TBW TBW TBW	CL BW SJM BW	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER 5518-R
REV.	DATE	DESCRIPTION	BY	CKD. BY			